


⏚ MAINS SAFETY EARTH

⏚ CHASSIS EARTH

⏚ P.S.U. GROUND

○ TERMINATION POINT

→ TO / FROM POINT

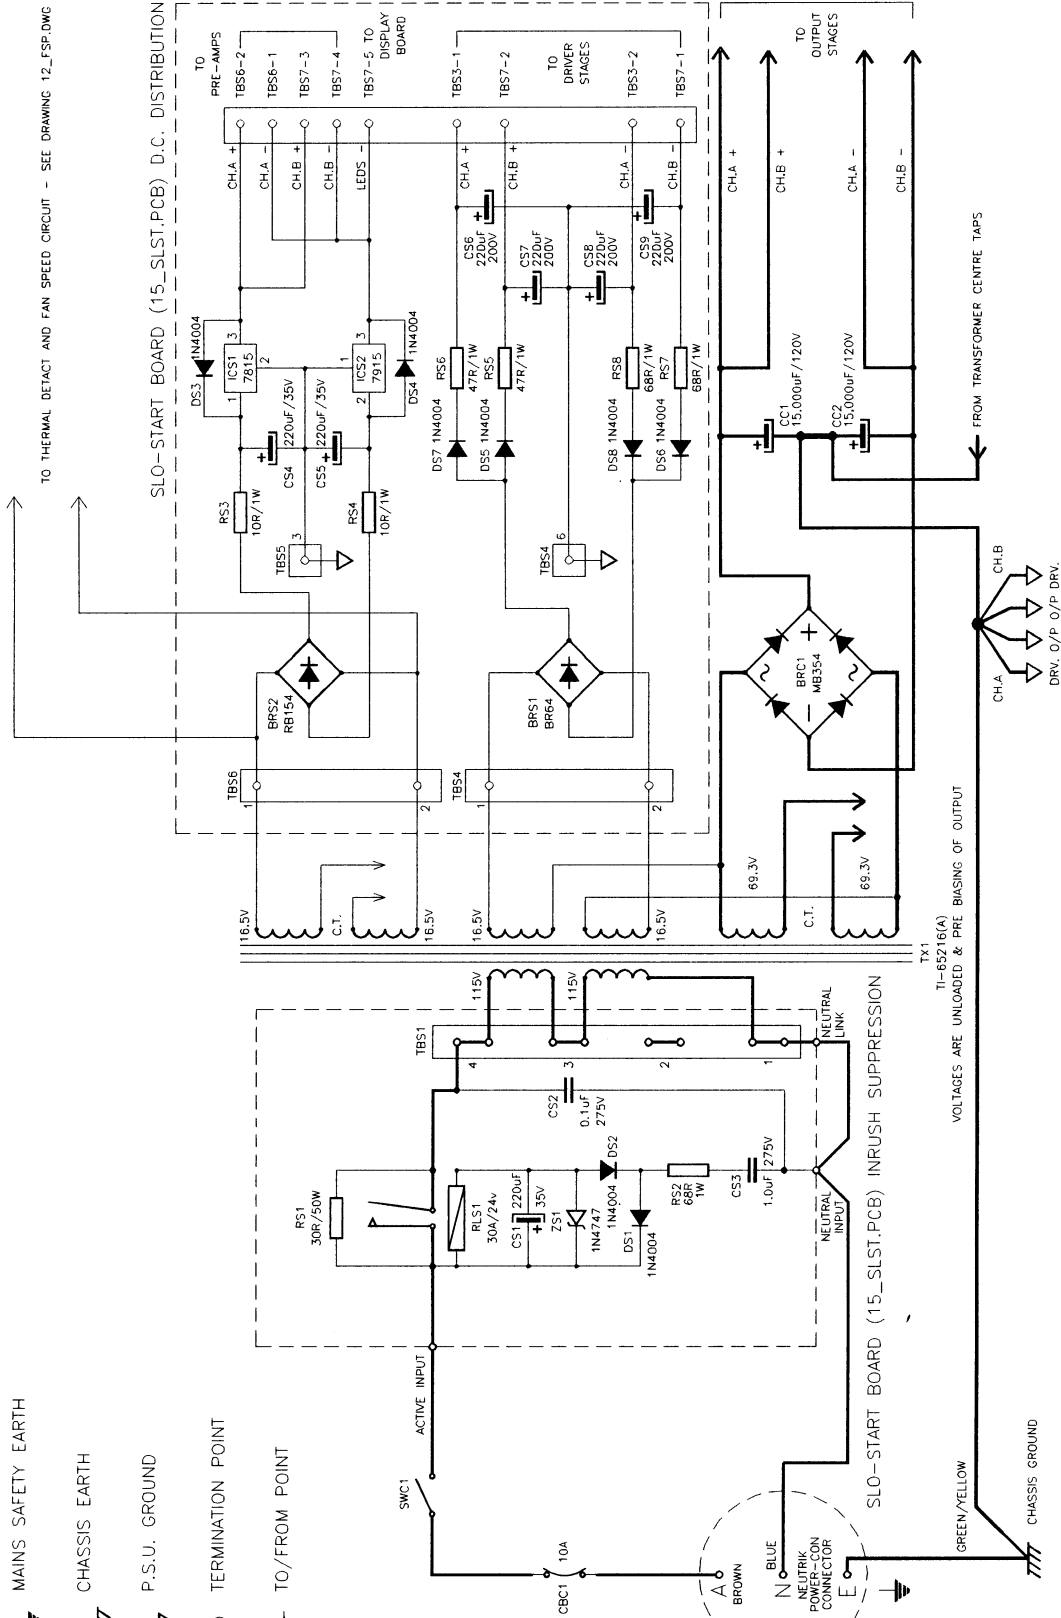

NOTE : ALL RESISTORS ARE 0.6 WATT EXCEPT WHERE NOTED.

THE RELAY CIRCUIT IS TOLERANCE SENSITIVE. CS-3 MUST HAVE A TOLERANCE OF -0/+20%		REVISION NOTE ORIGINAL		DRN / APP SMGL	DATE 5/5/99
AUDIO TELEX COMMUNICATIONS P/L 149 BEACONSFIELD STREET SILVERWATER NSW 2128 Phone: 61-(0)2-9647-1411 Fax: 61-(0)2-9748-2537		PRODUCT ASPECT SHOWING		PA1500 POWER SUPPLY CIRCUIT DIAGRAM re 230V	
Australian Monitor		DRAWING/CAD REFERENCE 15PSU230		REV A	DATE 5-5-99 SHEET 5 OF 7